## AWTA PRODUCT TESTING

Australian Wool Testing Authority Ltd - trading as AWTA Product Testing A.B.N 43 006 014 106

1st Floor, 191 Racecourse Road, Flemington, Victoria 3031 P.O Box 240, North Melbourne, Victoria 3051 Phone (03) 9371 2400

## **TEST REPORT**

Client: Hotel Carpet

2099 Princes Hwy Clayton VIC 3168 Test Number :

24-000247

Issue Date

14/02/2024

**Print Date** 

4/03/2024

Sample Description

Clients Ref :

"Axminster 7x8"

Cut pile carpet

Colour: Black

Black/Grey/Blue

End Use: Flooring

Nominal Composition: 80% Wool, 20% Nylon


NYION

Nominal Mass per Unit Area/Density:

1287g/m2

Nominal Thickness:

7mm

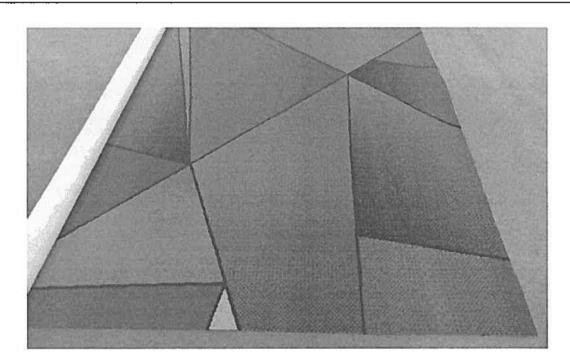

316665

68861

Page 1 of 2





Accredited for compliance with ISO/IEC 17025 - Testing Accreditation Numbers: 983, 985, and 1356

Samples and their identifying descriptions have been provided by the client unless otherwise stated. AWTA Ltd makes no warranty, implied or otherwise, as to the source of the tested samples. The above test results relate only to the sample or samples tested. This document shall not be reproduced except in full and shall be rendered void if amended or altered. This document, the names AWTA Product Testing and AWTA Ltd may be used in advertising providing the content and format of the advertisement have been approved by the Managing Director of AWTA Ltd.

AlDala.

Fiona McDonald

APPROVED SIGNATORY



## AWTA PRODUCT TESTING

Australian Wool Testing Authority Ltd - trading as AWTA Product Testing A.B.N 43 006 014 106

1st Floor, 191 Racecourse Road, Flemington, Victoria 3031 P.O Box 240, North Melbourne, Victoria 3051 Phone (03) 9371 2400

## TEST REPORT

Client: Hotel Carpet

2099 Princes Hwy

Clayton VIC 3168

Test Number :

24-000247

Issue Date

14/02/2024

Print Date

4/03/2024

AS 4586-2013 Appendix A Slip Resistance Classification of New Pedestrian Surface Materials

**Dry Pendulum Test Method** 

Date of Testing

14-02-2024

Operator

AWTA Test Operator 4

Test Temperature

23 °C

Sample tested as received

Pile Direction Fixed/Unfixed Length

Slider No 96 Batch No

Unfixed

23

Length

)

4 70

SRV

British Pendulum

72

70

71

5 70

SRV 71

Number

Classification (Surface tested dry)

P5


Equipment: Cooper Pendulum Skid Tester Serial No: 1433-01 Calibrated 11/10/2023 Slider prepared using P400 and 3µm lapping film.

These results apply only to the specimens tested and it is recommended that before selection of flooring or paving materials the effect of service conditions, including maintenance and wear on their slip resistance be checked.

316665

68861

Page 2 of 2





Accredited for compliance with ISO/IEC 17025 - Testing Accreditation Numbers: 983, 985, and 1356

Samples and their Identifying descriptions have been provided by the client unless otherwise stated. AWTA Ltd makes no warranty, implied or otherwise, as to the source of the tested samples. The above test result relate only to the sample or samples tested. This document shall not be reproduced except in full and shalls be rendered void if amended or altered. This document, the names AWTA Product Testing and AWTA Ltd may be used in advertising providing the content and format of the advertisement have been approved by the Managing Director of AWTA Ltd.

Fiona McDonald



MICHAEL A. JACKSON B.Sc.(Hons)